


FINAL INSPECTED MOTORS MUST COMPLY WITH ELECTRIC MOTOR VIBRATION SPECIFICATION (ES049)

THIRD ANGLE PROJECTION.

Q.R. No.		6738		CUSTOMER NO.		-	
CUSTOMER		VARIOUS					
MOTOR RATING	VOLTS	240	Hz	50	Ph	1	Duty AOM
	RPM.	890			2.0 AMPS		
	NOM. OUTPUT	200 WATTS					
ROTATION		ANTI CLOCKWISE AT LEAD END					
CAPACITOR	START	-----	μF/V	RUN	4/440 μF/V		
ENCLOSURE		VENTED					
MOTOR TYPE		CSR		INSULATION CLASS		B130	
THERMAL PROTECTION		AUTO RESET OVERLOAD					
APPLICATION		FAN COIL UNIT - SHAFT HORIZONTAL					
BEARING D.E.		6202ZZ			LUBRICATION		LONG LIFE, WIDE RANGE
BEARING N.D.E.		6202ZZ					
SUPPLY LEAD		SINGLE CORE MAIN LEADS 1600 CAP LEADS 400 ± 30 BRAIDED SLEEVING					
EARTH PROVISION		VIA SUPPLIED LEAD					
BASIC BUILD SPECIFICATION		305-570-02			PAINT/ COLOUR		PC GREY PLAIN E/SHIELDS
PERFORMANCE SPECIFICATION		SP85047-01					
CONNECTION DIAGRAM		393-402-04			RATING LABEL		AS SHOWN

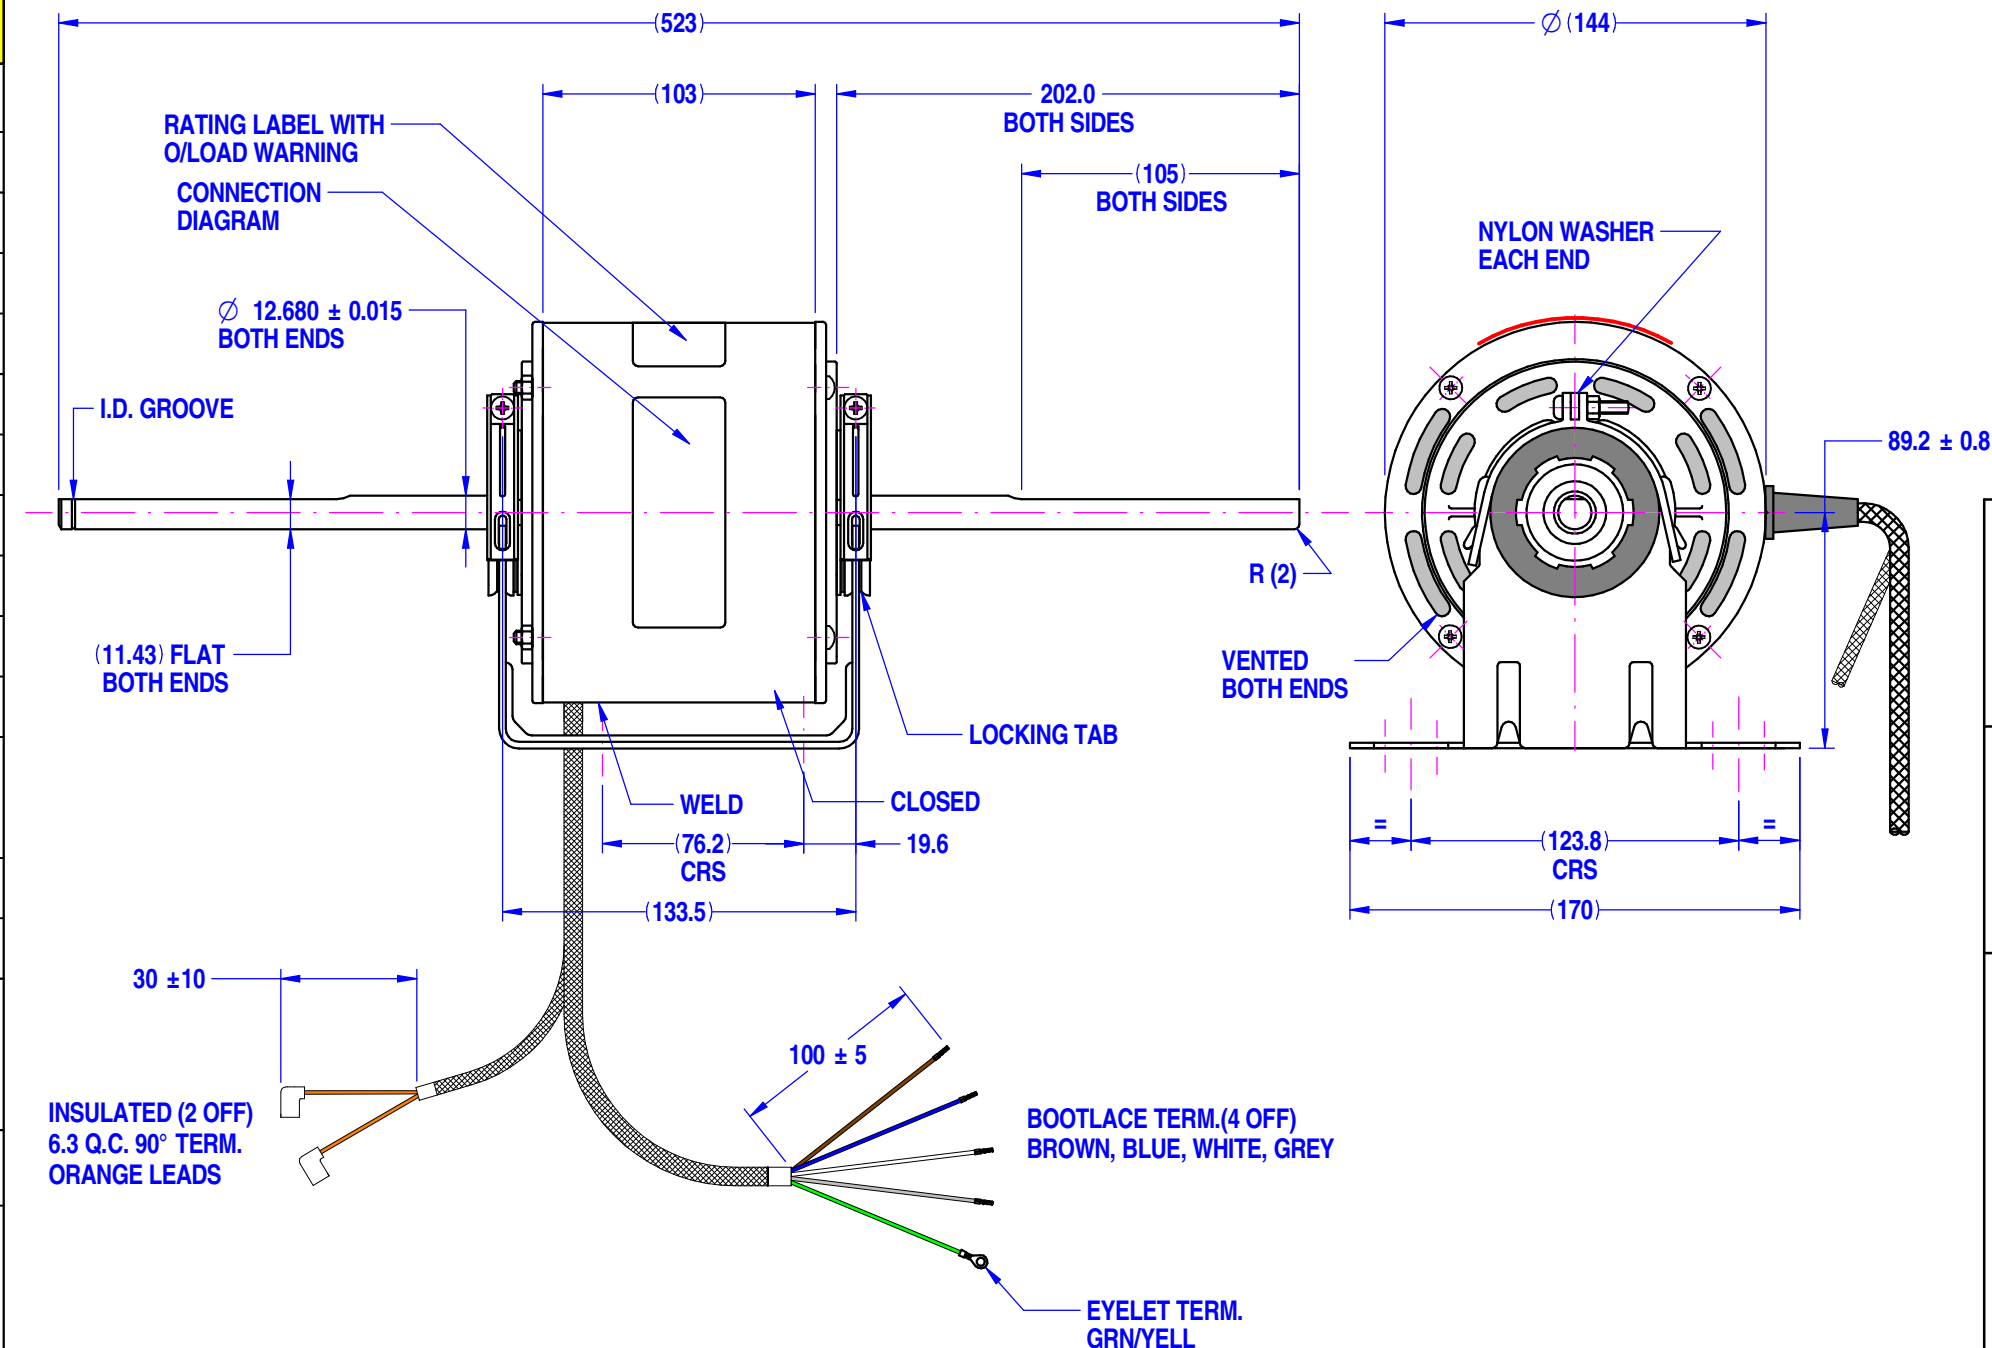

MIC1804207

Date: 17/10/2018

Note:



	ddmmyyxxxx
--	------------

MODEL	8061S004-80
-------	-------------

VOLTS	240	R.P.M.	890	CLASS	B130	Hz	50
WATTS	200	TYPE	CSR	μF/V S	NIL	Ph	1
AMPS	2.0	DUTY	AOM	μF/V R	4/440	PROT.	AUTO

WARNING

MOTOR FITTED WITH INTERNAL AUTO RESET
OVERLOAD AND MAY RESTART WITHOUT WARNING

- 1)_INSULATORS SE101-15 TO BE FITTED TO BOTH FLAG TERMINALS
- 2)_CAPACITOR SUPPLIED LOOSE WITH MOTOR.

THIS DRAWING REMAINS THE PROPERTY OF FASCO
MOTORS AND MAY NOT BE USED, COPIED OR ISSUED
WITHOUT WRITTEN PERMISSION FROM FASCO MOTORS

7.0

kg.

DRAWN	Veeranut	17/10/2018
CHECKED	Pipat	27/10/2018
RELEASED	Kanapote	01/11/2018
SCALE	NTS	



29/7-8 MOO 3, BANGKRUAY - SAINOI Rd.,
BANGKRANG, MUANG NONTABURI DISTRICT,
NONTABURI 11000 THAILAND

A3

B047:8557V-200-GDD

T	DWG. NO.
---	----------

8061S004-80

REVISION

N