


THIRD ANGLE PROJECTION.

c

MOTOR SPECIFICATION


8061S059-04S


		•	001			•	<u> </u>					
Q.R. No.		-			CUSTOMER NO.		NO.		-			
	CUSTOMER			VARIOUS								
	VOLTS	24	10	Hz	50	Ph	1	Duty	,	AOM		
MOTOR RATING	RPM.	920					0.9	9	AMPS			
	NOM. OUTPUT		1	150 WATTS								
	ROTATION	CLOCKWISE DRIVE END										
CAPACITOR		START		μF/	μF/V RUN		6/44		μF/\			
	ENCLOSURE	TOTALLY ENCLOSED										
MOTOR TYPE		CSR			I	INSULATION CLASS				B130		
THERMA	L PROTECTION		AUTO RESET OVERLOAD									
	APPLICATION			FAN - SHAFT HORIZONTAL								
	BEARING D.E.		620	2ZZ	1	LUBRICATION LONG LIFE						
В	EARING N.D.E.		620	2ZZ				WIDE RANGE				
	SUPPLY LEAD			FLE)	K MAIN Cap.	MAIN LEAD 1600 ± 30 GREY						
EAR	TH PROVISION	VIA SUPPLIED LEAD										
SP	BASIC BUILD ECIFICATION	30	05-570)-05		PAI	NT/		PC GREY PLAIN E/SHIELDS			
	RFORMANCE PECIFICATION	SI	P8506	4-01		COL	OUR	PLA				
(CONNECTION DIAGRAM		393-1	79		RAT LAE	-	SS	ΓDΑ	UTO.FMT		

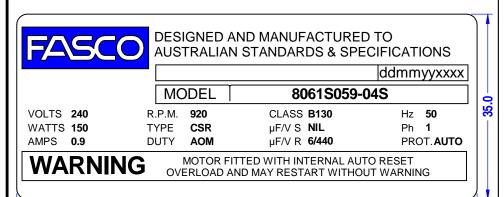

- 87.0 -

FINAL INSPECTED MOTORS MUST COMPLY WITH ELECTRIC MOTOR VIBRATION SPECIFICATION (ES049)

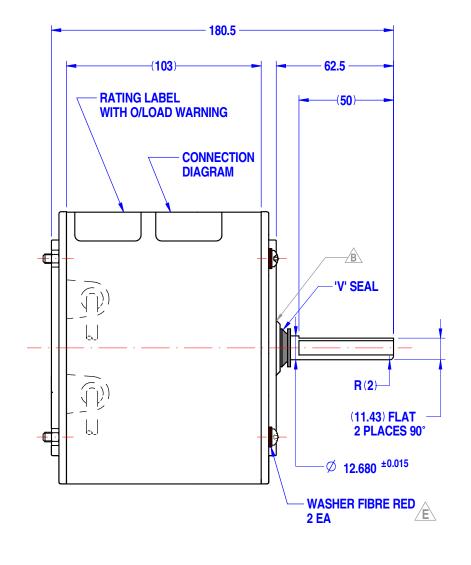

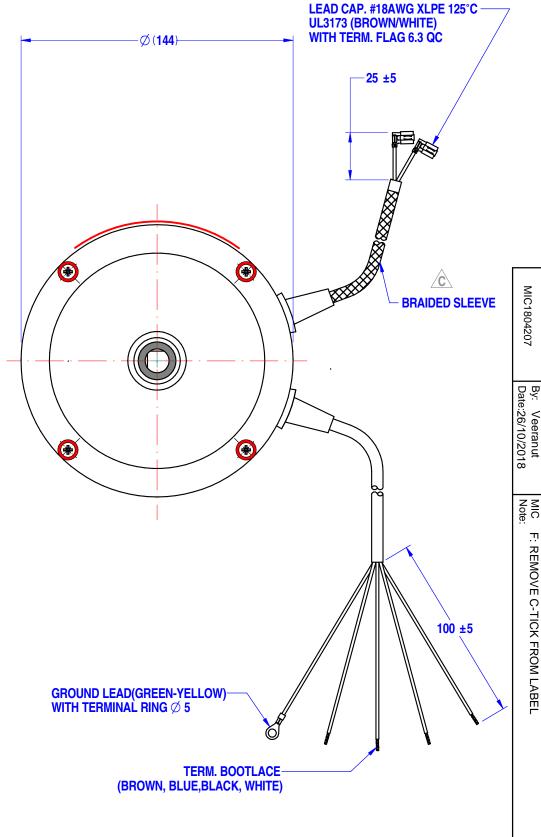

SPECIAL REQUIREMENTS:

- 1)_ "V" RING SEAL FITTED ON SHAFT.
- 2)_ WASHER FIBRE TO BE FITTED ON TIE RODS DE ENDSHIELD.
- 3) CAPACITOR SUPPLIED LOOSE WITH MOTOR.
- 4) MOTOR TO BE PACKED IN SINGLE CARTON.

UNLESS OTHER	WISE SPECIFIED
DIMENSIONS	ARE IN MM.
TOLEF	RANCES
DECIMALS	ANGULAR
.X ± 1.0	± 30'

THIS DRAWING REMAINS THE PROPERTY OF FASCO

 $.XX \pm 0.1$

6.0 DRAWN 12/07/2006 muntana CHECKED Pipat 27/10/2018 Kanapote 01/11/2018 RELEASED MOTORS AND MAY NOT BE USED, COPIED OR ISSUED WITHOUT WRITTEN PERMISSION FROM FASCO MOTORS SCALE N.T.S.

MOTOR WEIGHT



29/7-8 MOO 3, BANGKRUAY - SAINOI Rd., BANGKRANG, MUANG NONTHABURI DISTRICT. NONTHABURI 11000 THAILAND

А3

RAME	MOTOR	
R	B064:8557T-150-XAD	
SHEET	DWG. NO.	REVISION
Δ3	8061S059-04S	F