


| No | Item | Specification |
|----|-----------------------|---------------------------|
| 1 | Compressor | MTZ 080 (Maneurop) |
| 2 | Condenser | 3 Row |
| 3 | Fan Motor | 2 x 450mm (EBM) |
| 4 | Receiver | 12L (TEM) |
| 5 | Oil Separator | 5/8" (Castel) |
| 6 | Suction Line Strainer | 1 1/8" (Henry/Heldon) |
| 7 | Filter Drier | 5/8" (Danfoss) |
| 8 | Sight Glass | 5/8" (Castel) |
| 9 | Solenoid Valve | 5/8" (Danfoss) |
| 10 | Fan Speed Control | Carel |
| 11 | Electrical Box | TEM |
| 12 | Pressure Switch | KP15 060-183491 (Danfoss) |



| | | | | | | |
|-----|-----|-------------------------------|----------|-------|---------|----------|
| 9 | J | Change Suction line strainer. | 19/02/20 | rudy | Ijat | Sham |
| 8 | H | Change pressure switch. | 12/02/20 | rudy | Ijat | Sham |
| 7 | G | Change electrical box. | 31/10/19 | rudy | Ijat | Sham |
| 6 | F | Change model name. | 07/10/19 | rudy | Ijat | Sham |
| No. | Ind | Modification | Date | Drawn | Checked | Approved |

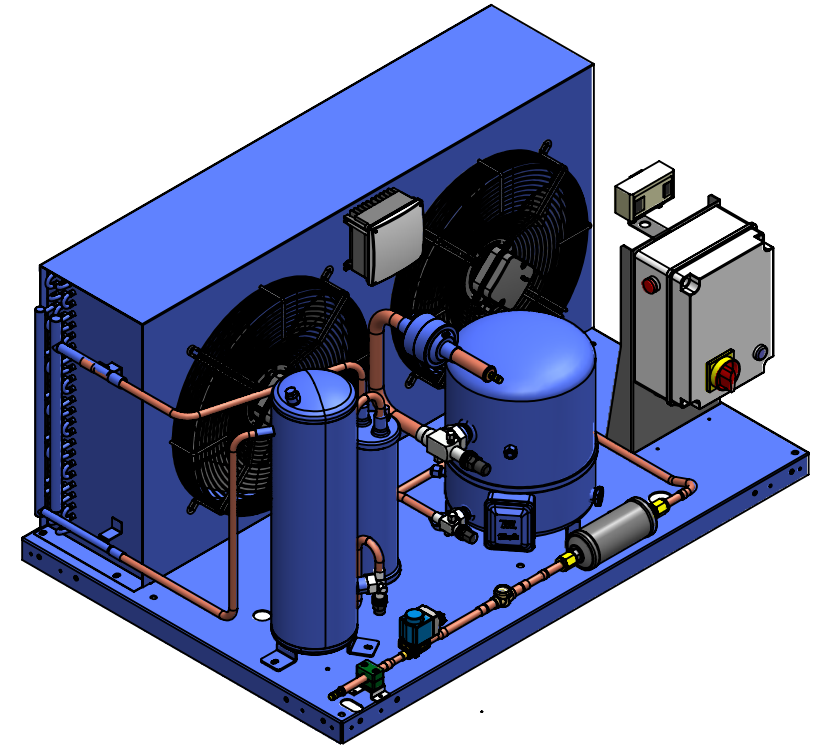

| | | | |
|-------------|-----------------|----------|------|
| Model | GH144MHA1-2 | Drawn | rudy |
| Description | Condensing Unit | Checked | Ijat |
| Drawing No. | TEM19/CU/003 | Approved | Sham |
| Date | 18/01/2019 | Index | J |



TECUMSEH EURO-MALAYSIA SDN BHD