


COMPAC PAS SCROLL SINGLE PHASE

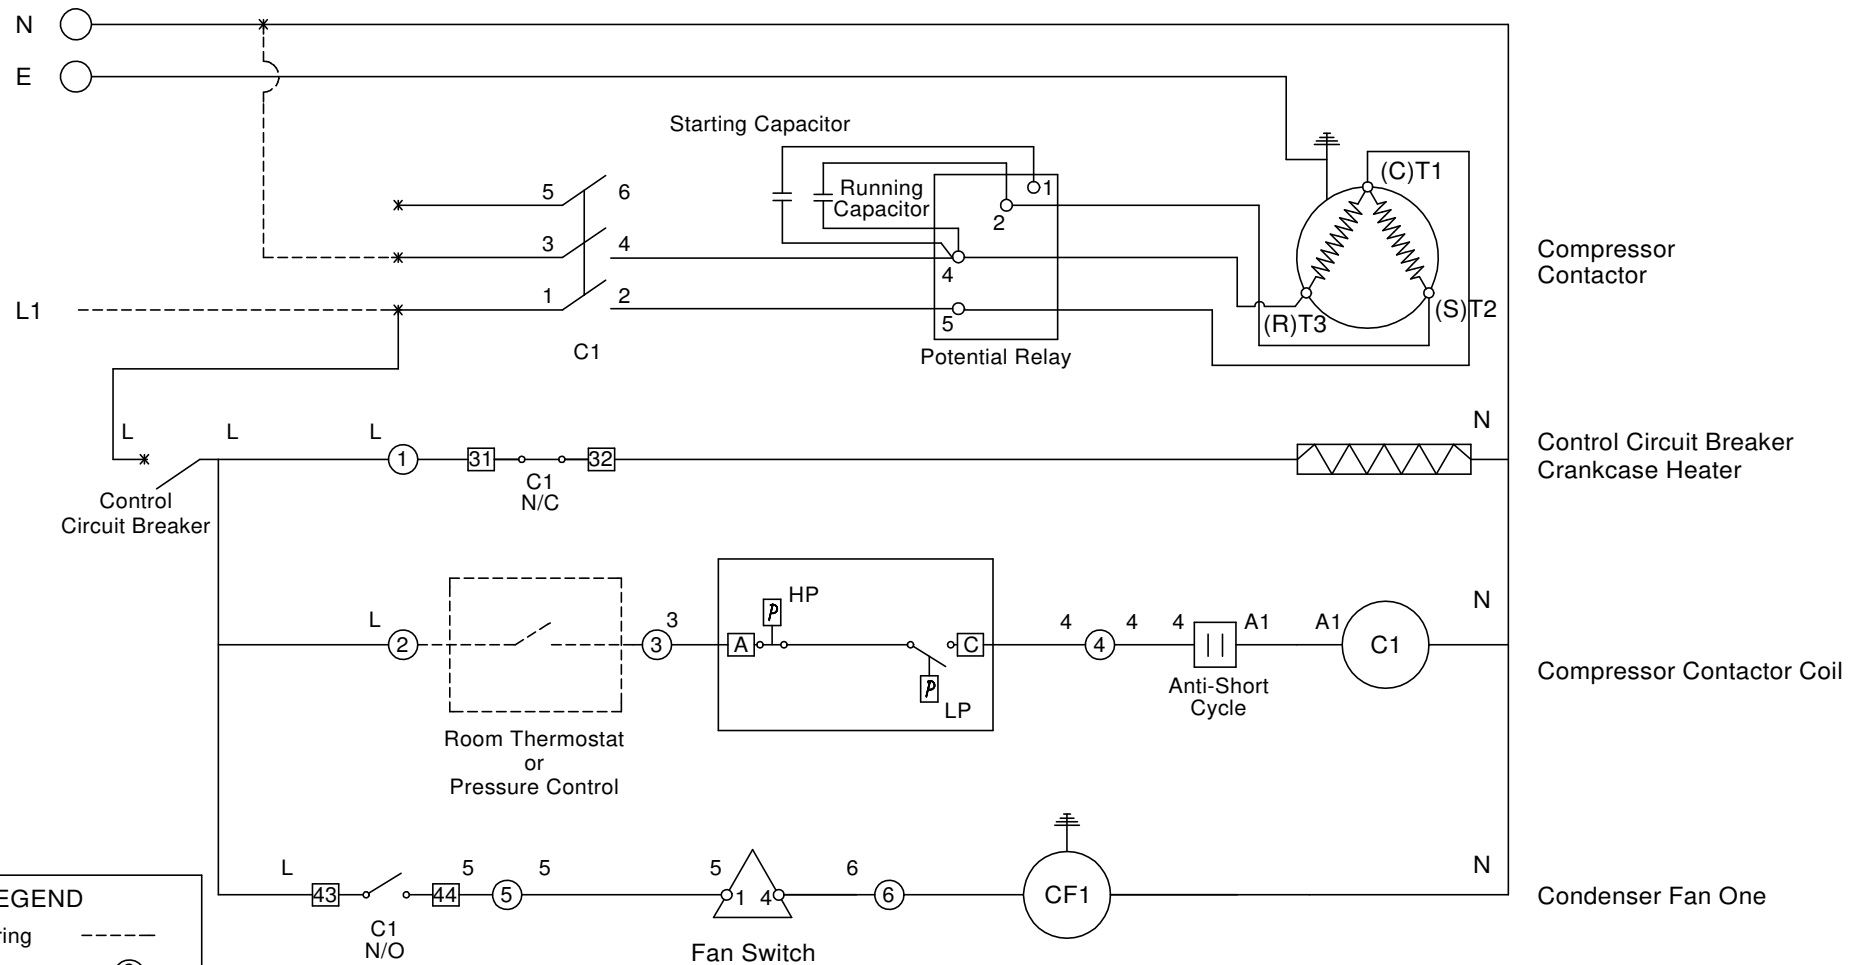

WARNING

THE ELECTRICAL CONNECTION OF THIS UNIT
MUST BE PERFORMED BY QUALIFIED
PERSONNEL AND MUST COMPLY WITH LOCAL
ELECTRICAL STANDARDS