
# XE70 SERIES

# T6376/T6377

# THERMOSTATS HEATPUMPS & SMALL AIR CONDITIONERS

#### PRODUCT SPECIFICATION SHEET

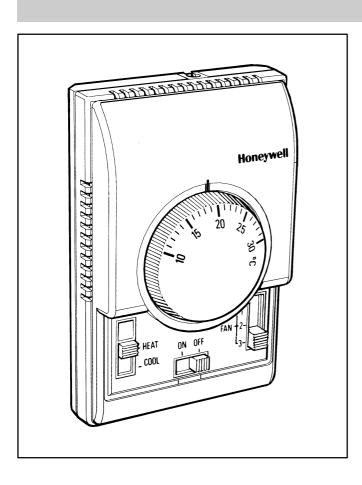

The T6376 and T6377 are designed to control the valves, the fan and the compressor in split units, heatpumps and small air conditioners.

The thermostat operates the compressor to provide either heating or cooling (as selected by the system switch) at the desired setpoint temperature.

The fan can also be controlled from the thermostat. In some cases it is wired to run continuously, and can be switched off with the system ON/OFF switch, while with other models there is a switch which gives the choice of running the fan continuously, or cycling it with the thermostat.

Versions are available with a manual 3-SPEED FAN switch, and with a system ON/OFF switch, or a HEAT/OFF/COOL switch

Heat/cool changeover operation can be accomplished either by a manually operated HEAT/FAN/ COOL switch or a HEAT/OFF/ COOL switch on the front of the thermostat.

## **FEATURES**

- Dual diaphragm sensing element ensures close temperature control for all loads and applications
- Attractive modern styling makes this thermostat ideal for locating in the occupied space, particularly in offices or hotels
- Versions with heat anticipator, which improves temperature control in both heating and cooling operation
- Thermostat mounts directly onto a wall or conduit box
- Slide switches allow manual control of system operation and fan speed
- Optional extras:
  - rangestops F42006646-001
  - tamperproof cover F42008489-001 (opaque), F42008489-002 (transparent)

## **SPECIFICATIONS**

| Model      | Switches |         |           |           |           |           |           | Features |            |
|------------|----------|---------|-----------|-----------|-----------|-----------|-----------|----------|------------|
|            | ON/OFF   | 3-speed | Fan/      | Heat/Cool | Heat/Cool | Heat/Off/ | Heat/Fan/ | Fixed    | Auto       |
|            |          | Fan     | Auto/Cont |           |           | Cool      | Cool      | Deadband | Change-    |
|            |          |         |           |           |           |           |           |          | over       |
|            | (SPST)   | (SPTT)  | (SPDT)    | (SPDT)    | (DPDT)    | (DPTT)    | (DPTT)    |          | (Aquastat) |
| T6376B1004 |          |         | ✓         |           |           | ✓         |           |          |            |
| T6377B1003 | ✓        | ✓       |           |           |           |           | ✓         |          |            |
| T6377B1011 |          | 1       | 1         |           |           | 1         |           |          |            |
| T6377B1045 |          | 1       | 1         |           |           | 1         |           |          |            |

: 10...30°C. By means of a large setpoint Setpoint range

Supply voltage : 230 V~, 50...60 Hz

**Thermostat** switch

: S.P.D.T.

: Typical differential 1 °C (heating & Performance

cooling) at 20°C at 50% load with

anticipator connected

Electrical ratings: 4(2) A, 230 V~

Typical loads are fans, zone valves, relays, compressors. Compressors of greater than 0.5 kW capacity should be

switched via a contactor.

: Greater than 100,000 cycles (all loads) Operational life

for thermostat contacts at 230 V~ Greater than 6,000 operations for all

manually operated switches

Mounting : Mounts directly onto wall or wall-box

(mounting screws supplied)

Wiring : Up to 9 screw-in terminals per unit, capable of accepting wires up to 1.5 mm<sup>2</sup>

**Enclosure** : Plastic 2-piece housing

Dimensions : 85 x 130 x 40 mm (w x h x d)

Protection class

Environmental requirements

Operating temperature range 0 to 40°C Shipping and storage temperature range

-20 to 50°C

Humidity range 0 to 90% rh, non-

condensing


Approvals : CE mark, complying with standards

EN60730-1 (1995), EN55014-1 (1997),


EN55014-2 (1996).

Product must be wired as shown for CE

# **DIMENSIONS**

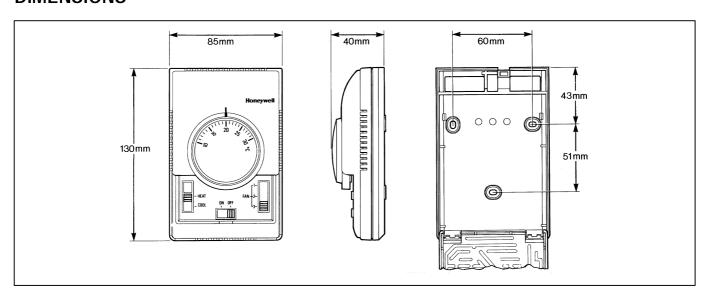

#### INSTALLATION

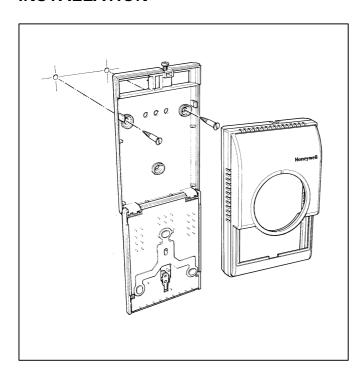

# **OPERATION**

## Sensing element

The thermostat sensing element comprises two circular, flexible metal plates welded together at the rims and encapsulating a gas/liquid combination whose pressure changes in response to variations in temperature. This dual-diaphragm expands and contracts with ambient temperature changes to operate a snap-acting switch which controls the heating or cooling circuit.

#### **Heat anticipator**

It is recommended that the heat anticipator is always connected for both heating and cooling operation.

#### Location

The XE70 Series thermostat is the temperature control element in the fan-coil or air-conditioning system, and must be located in a position with good air circulation, on an inside wall about 1.5 m above the floor to sense the average temperature. Do not position the thermostat in draughts, near hot or cold air sources or where it will be affected by radiant heat from the sun or other appliances.

#### Mounting the thermostat

Any XE70 Series thermostat can be directly mounted on the wall or on a conduit box (see diagram). Mounting screws are supplied for both alternatives.

#### Wiring the thermostat

The standard wiring access is via a hole in the base of the thermostat, near the top edge.

#### **IMPORTANT**

- 1. The installer must be a trained service engineer
- 2. Disconnect the power supply before beginning installation

#### **Switches**

All switches are slide switches for ease of operation.

The ON/OFF switch is a system on/off switch, as it removes power from the thermostat.

The FAN SPEED switch allows selection of 3 different fan speeds, 1 (low), 2 (medium), and 3 (high).

The FAN AUTO/CONT switch allows The choice of 2 different operating modes for the fan - either continuously (cont), or cycled by the thermostat (auto)


The DPTT HEAT/OFF/COOL and HEAT/FAN/COOL switches allow selection of either heating or cooling operation, but also have an additional selection position which disables all the outputs except that of the fan. In both these cases the fan can be controlled separately, either by the system ON/OFF switch or by the FAN AUTO/CONT


# **APPLICATION**


|                       |  | T6376B<br>1004     | T6377B<br>1003    | T6377B<br>1011      | T6377B<br>1045                  |
|-----------------------|--|--------------------|-------------------|---------------------|---------------------------------|
| Application           | Ventilation 2-pipe fan-coil 4-pipe fan-coil Heatpump Air-conditioner   | *                  | *                 | *                   | *                               |
| Control<br>Capability | Heat or Cool Heat/cool Changeover (auto or manual) Fan control (auto or cont) Fan speed control Valve control Compressor control | * manual either  * | * manual cont * * | * manual either * * | *<br>manual<br>either<br>*<br>* |


3


# **WIRING**

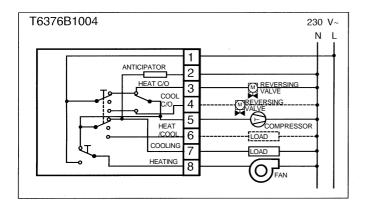

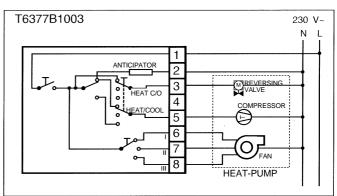

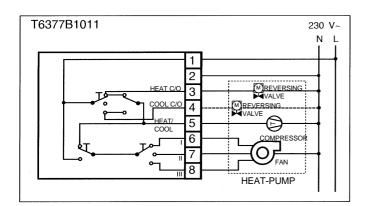

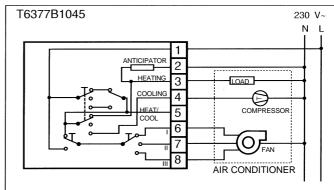

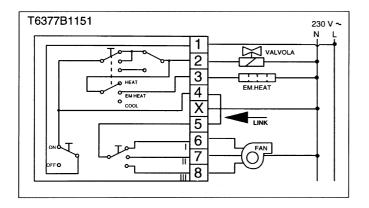

# Honeywell