


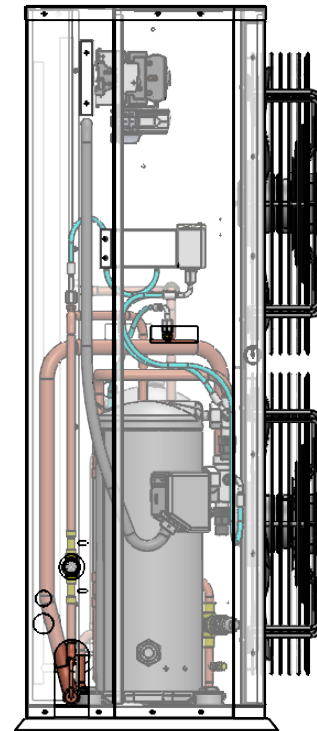


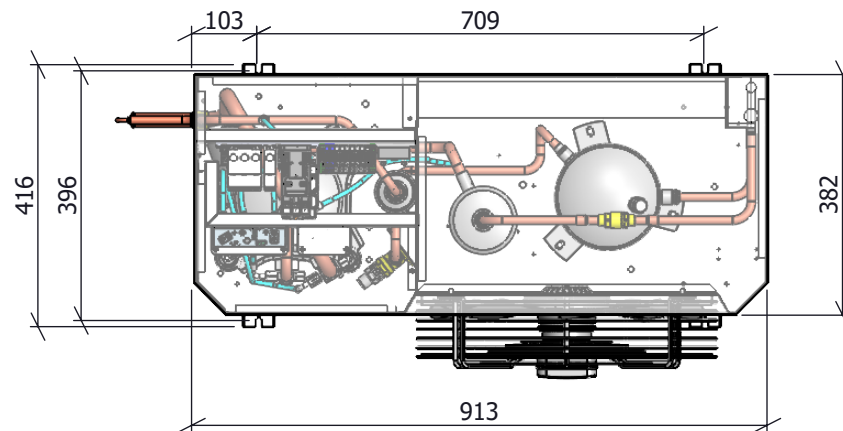

No	Item	Specification
1	Compressor	Scroll
2	Condenser	5mm - 6 Row (TEM)
3	Fan Motor	2 x 450mm (TEM)
4	Receiver	9.5L (TEM)
5	Oil Separator	5/8" Helical (HPEOK PKW 04-05)
6	Check Valve	1/2" (Castel)
7	Filter Drier	1/2" (Castel-DF 316/4)
8	PCLV	1/2" (Castel)
9	Sight Glass	1/2" (Castel)
10	Pressure Switch	KP17 (TEM)
11	Fan Switch	KP5 (Danfoss)

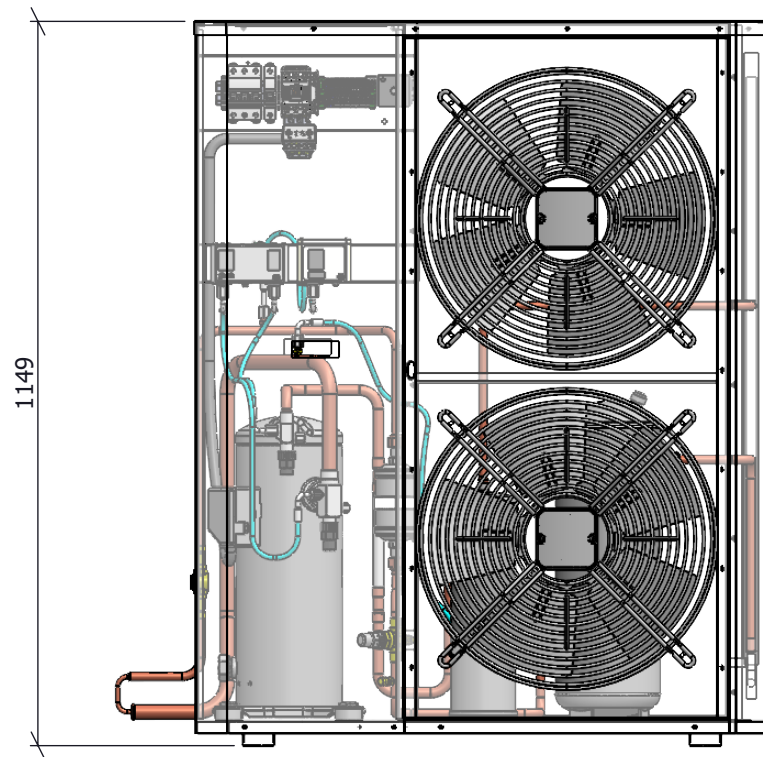

6	F	Add mounting dimension.	17/08/20	rudy	Ijat	Sham
5	E	Change receiver tube type.	17/07/20	rudy	Ijat	Sham
4	D	Add vibration tube.	03/07/20	rudy	Ijat	Sham
3	C	Change model name.	01/06/20	rudy	Ijat	Sham
No.	Ind	Modification	Date	Drawn	Checked	Approved

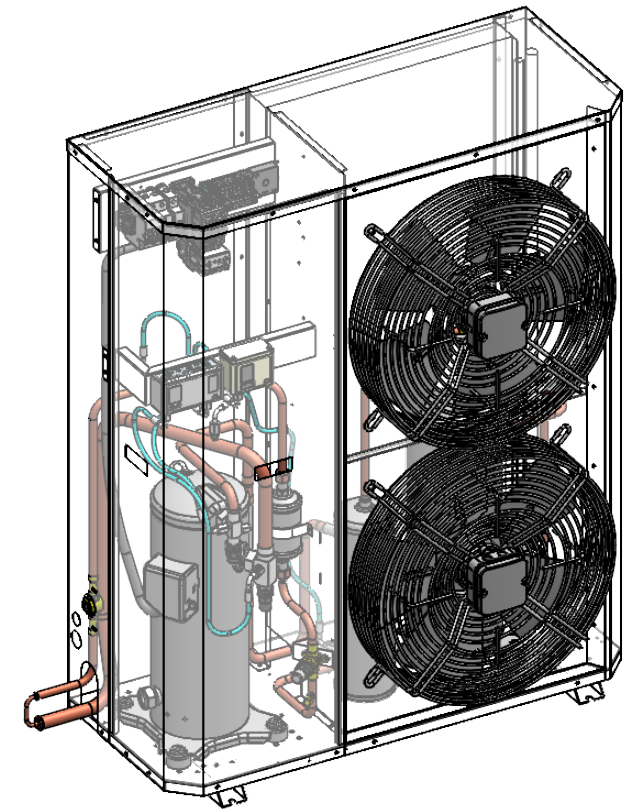

Model	PAS4572Z-3	Drawn	rudy
Description	Compact Scroll Large-6hp	Checked	Ijat
Drawing No.	TEM19/CU/079	Approved	Sham
Date	09/03/2020	Index	F

TECUMSEH EURO-MALAYSIA SDN BHD